



Midea Building Technologies Division

Engineering Data

King Plus



CONTENTS

Part 1 General Information.....	3
Part 2 Engineering Data	11
Part 3 Installation and Field Settings.....	25

Part 1

General Information

1 System introduction	4
2 Product lineup.....	7
3 Nomenclature	7
4 System Design And Unit Selection	8

1 System introduction


1.1 System Schematic

King Plus is an integrated air-to-water space heating and space cooling heat pump system. The outdoor heat pump system extracts heat from the outdoor air and transfers this heat through refrigerant piping to the plate heat exchanger in the hydronic system. The heated water in the hydronic system circulates to low temperature heat emitters (floor heating loops or low temperature radiators) to provide space heating. The 4-way valve in the outdoor unit can reverse the refrigerant cycle so that the hydronic system can provide chilled water for cooling using fan coil units.

The heating capacity of heat pumps decreases with ambient temperature. King Plus is reserved an auxiliary electric heater control port to provide additional heating capacity for use during extremely cold weather when the heat pump capacity is insufficient. The auxiliary electric heater also serves as a backup in case of heat pump malfunction and for anti-freeze protection of the outside water piping in winter.


1.2 Typical Applications

1.2.1 Space Heating Through Floor Heating Loops

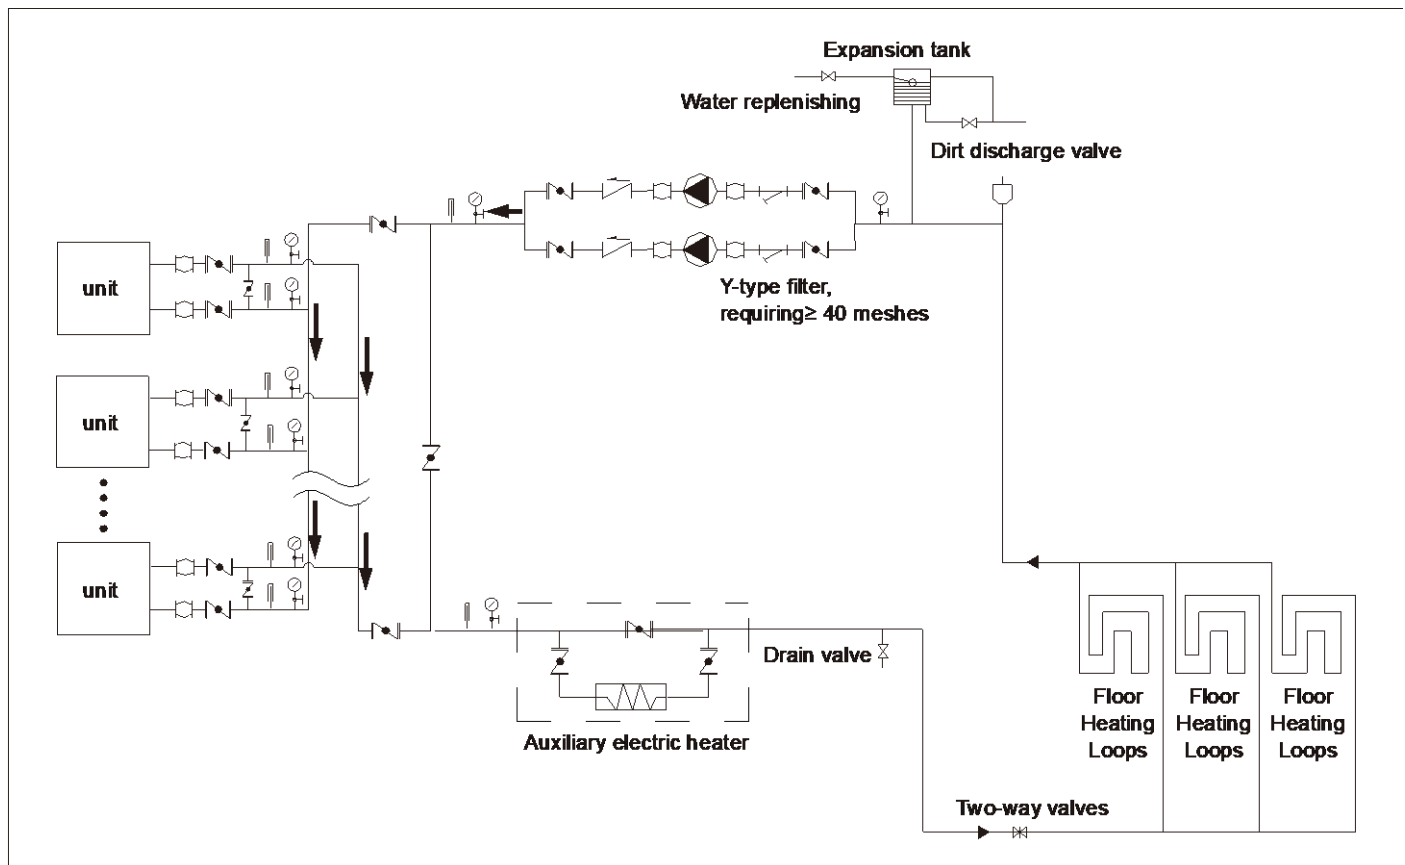

Legend				
Stop valve	Pressure gauge	Flexible joint	Gate valve	Automatic discharge valve
Y-shaped filter	Thermometer	Circulating pump	Check valve	

1.2.2 Space Cooling and Heating through Fan Coil Unit

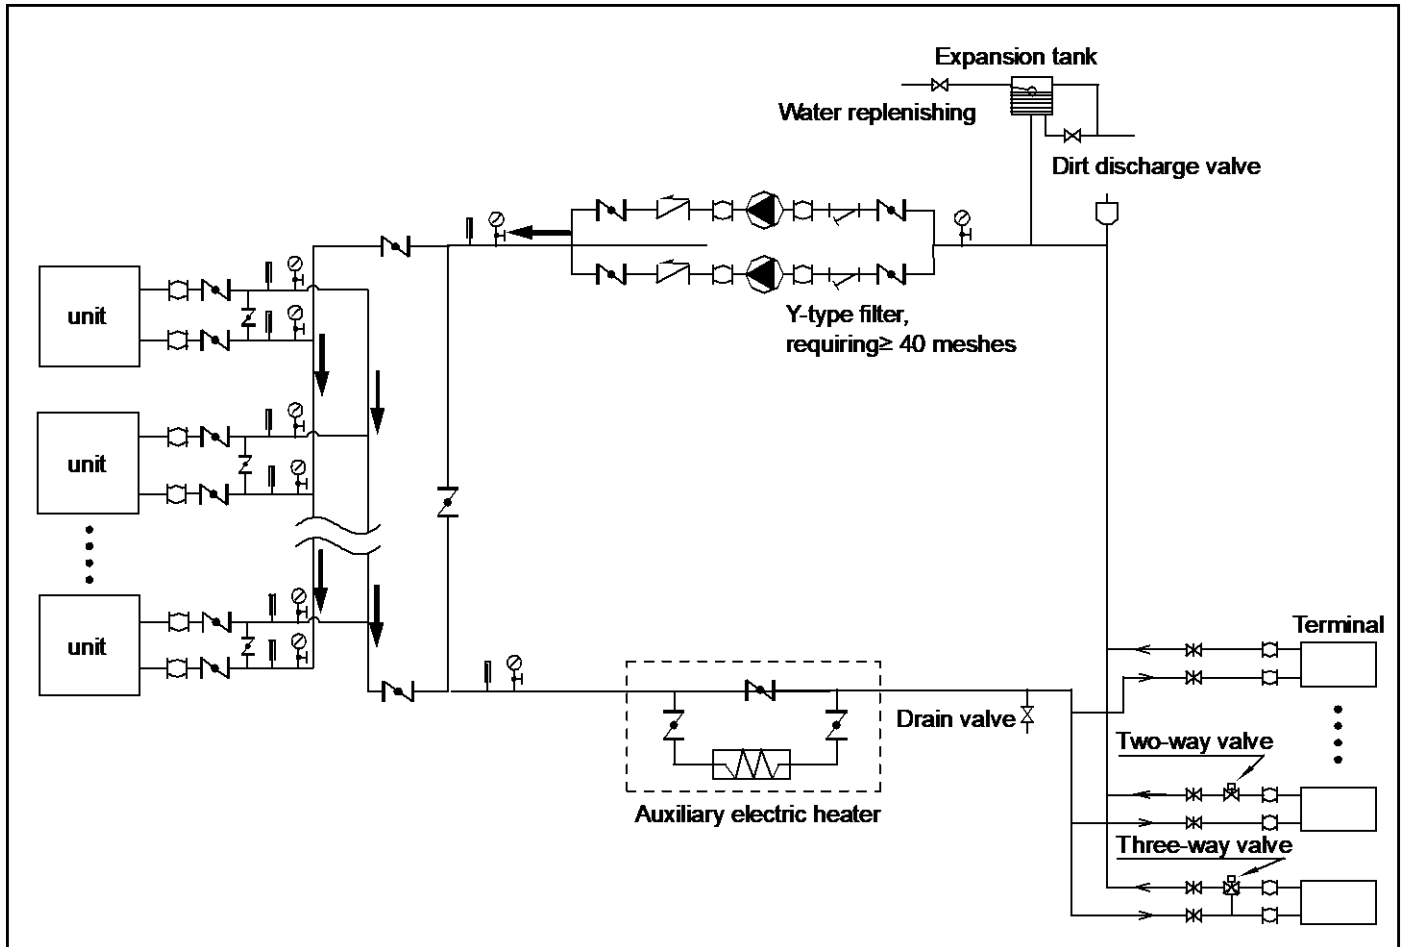


Legend				
Stop valve	Pressure gauge	Flexible joint	Gate valve	Automatic discharge valve
Y-shaped filter	Thermometer	Circulating pump	Check valve	

King Plus



1.2.3 Space Heating Through Floor Heating Loops and Space Cooling Through Fan Coil Unit

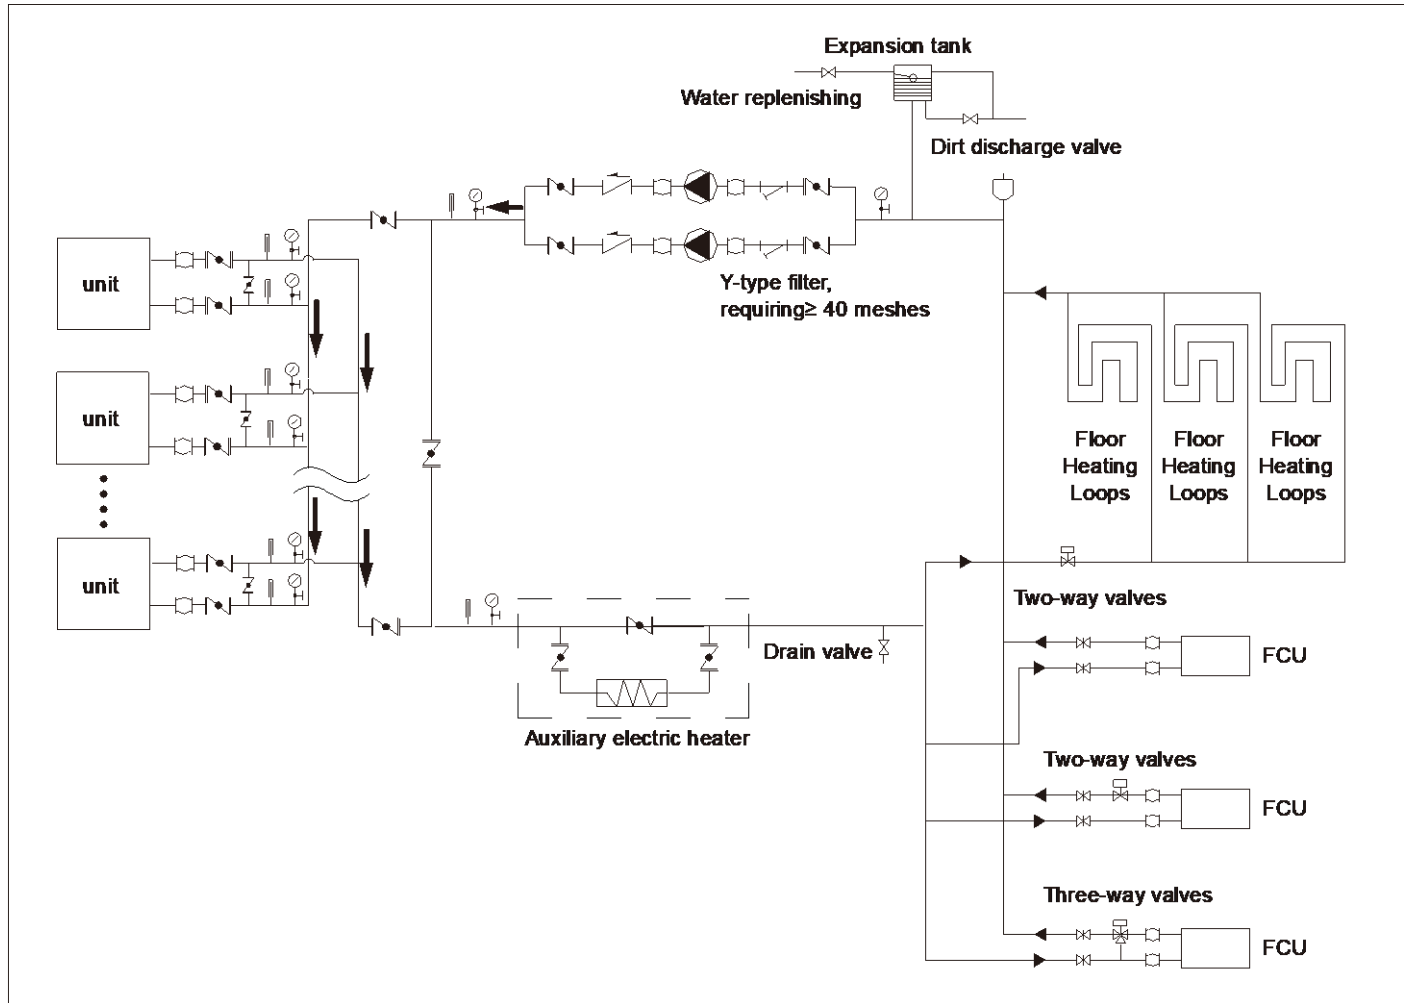

Legend				
Stop valve	Pressure gauge	Flexible joint	Gate valve	Automatic discharge valve
Y-shaped filter	Thermometer	Circulating pump	Check valve	


Note:

In space cooling mode, the 2-way valve on the floor heating branch circuit is closed to prevent cold water entering the floor heating loops.

2 Product lineup

Model	MC-SS130-RN1TL	MC-SS260-RN1TL
Power supply	380-415V/3Ph/50Hz	380-415V/3Ph/50Hz
Appearance		

3 Nomenclature

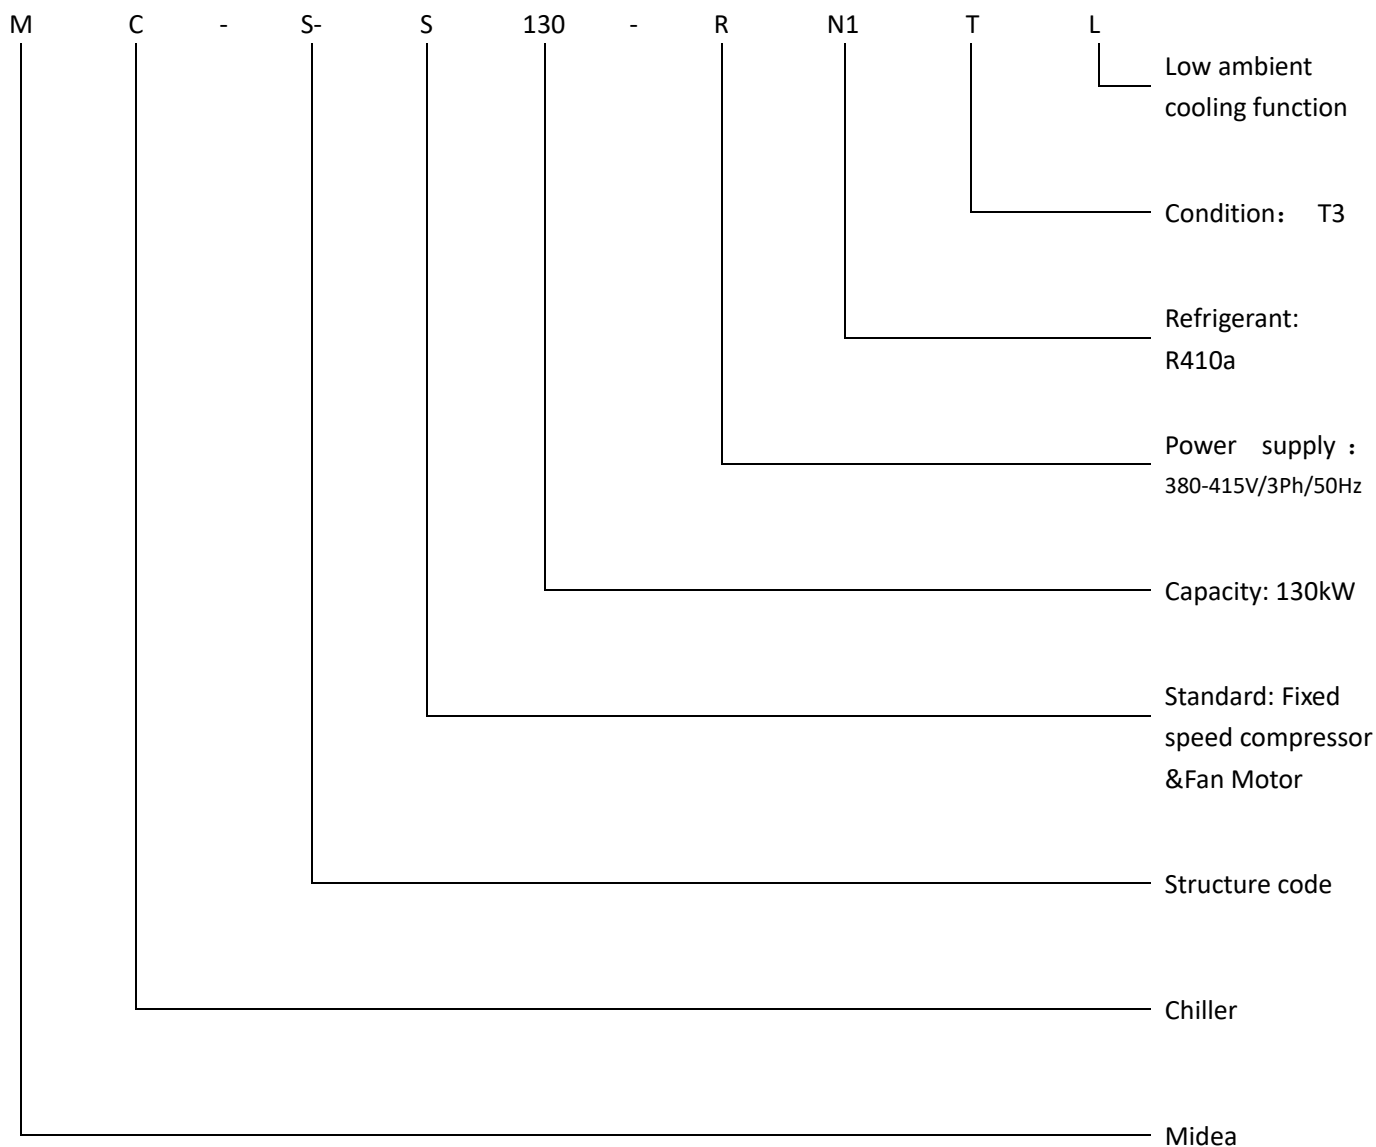

4 System Design and Unit Selection

4.1 Selection Procedure

Step 1: Total heat load calculation

Calculate conditioned surface area
Select the heat emitters (type, quantity, water temperature and heat load)

Step 2: System configuration

Decide whether to enable or disable auxiliary electric heater

Step 3: Selection of outdoor units

Determine required total heat load on outdoor units
Set capacity safety factor
Select power supply

Provisionally select Aqua thermal Series unit capacity¹ based on nominal capacity

Correct capacity of the outdoor units for the following items:
Outdoor air temperature / Outdoor humidity / Water outlet temperature² /
Altitude / Anti-freeze type

Is corrected capacity $\geq$ Required total heat load on outdoor units³

Yes

System selection is complete

No

Select a larger model or enable
auxiliary electric heater operation

Notes:

- Up to 16 units of 130kW (8 units of 260kW) can be connected together, giving a system cooling/heating capacity range from 130kW to 2080kW.
- If the required water temperatures of the heat emitters are not all the same, the outlet water temperature setting should be set at the highest of the heat emitter required water temperatures. If the water outlet design temperature falls between two temperatures listed in the outdoor unit's capacity table, calculate the corrected capacity by interpolation.
- Select unit which satisfies both total heating and cooling load requirements.

4.2 Modular Chiller Leaving Water Temperature (LWT) Selection

The recommended design LTW ranges for different types of heat emitter are:

- For floor heating: 30 to 35°C
- For fan coil units: 30 to 45°C
- For low temperature radiators: 40 to 50°C

4.3 Optimizing System Design

To get the most comfort with the lowest energy consumption, it is important to take account of the following considerations:

- Choose heat emitters that allow the heat pump system to operate at as low a hot water temperature as possible whilst still providing sufficient heating.

Part 2

Engineering Data


1 Specifications	12
2 Electrical Characteristics.....	13
3 Dimensions and Center of Gravity	14
4 Operating Limits.....	15
5 Capacity Tables.....	16
6 Performance Adjustment Factors	19
7 Hydronic Performance.....	21
8 Octave Band Levels	21

1 Specifications

Model name			MC-SS130-RN1TL	MC-SS260-RN1TL
Power supply		V/Ph/Hz	380-415V/3P/50Hz	380-415V/3P/50Hz
Cooling ¹	Capacity	kW	130	265
	Rated input	kW	42.3	84.0
	EER		3.07	3.15
Heating ²	Capacity	kW	138	280
	Rated input	kW	43	84.8
	COP		3.21	3.30
Air side heat exchanger	Type		Finned tube	Finned tube
	Fan motor type		DC MOTOR	DC MOTOR
	Fan motor rated	W	1600	1600
	Fan motor quantity		2	4
	Air flow rate	m³/h	39000	78000
Water side heat exchanger	Type		Shell- tube	Shell- tube
	Volume	L	Tube side: 12L / Shell side: 42L	Tube side: 12L / Shell side: 42L
	Rated water flow	m³/h	22.4	45.6
	Water flow range	m³/h	17.9-26.8	36.5-54.7
	Water pressure	kPa	40	60
Refrigerant system	Refrigerant type		R410A	R410A
	Refrigerant charge	kg	20	40
	Throttle type		EXV	EXV
Sound pressure level(1m) ³	Cooling ¹	dB(A)	74.8	78.0
	Heating ²	dB(A)	77.5	79.9
Net dimensions (W×H×D)	mm		1120*2300*2200	2753*2415*2220
Packed dimensions (W×H×D)	mm		1180*2445*2250	2810*2450*2290
Net weight	kg		831	1890
Gross weight	kg		852	1900
Water pipe connections	mm		DN65	DN100
Water pressure range	MPa		1.0	1.0
Controller			KJRM-120D/BMK-E(Modbus)	KJRM-120D/BMK-E(Modbus)
Operating temperature range	Cooling	℃	-10~52	-10~52
	Heating	℃	-15~24	-15~24
Water outlet temperature range	Cooling ⁴	℃	0-25	0-25
	Heating	℃	25-50	25-50

Notes:

1. Outdoor ambient temperature 35°C DB. EWT 12°C, LWT 7°C;
2. Outdoor ambient temperature 7°C DB/6°C WB. EWT 40°C, LWT 45°C;
3. Sound pressure level is the test average measured in a semi-anechoic chamber. The test position is 1m right in front of the unit for four sides and (1+H)/2m (where H is the height of the unit) above the floor. During in-situ operation, sound pressure levels may be higher as a result of ambient noise.

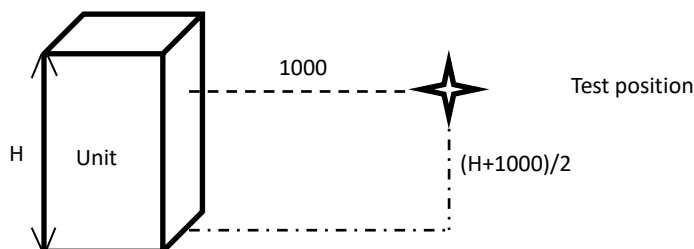

4. Antifreeze liquid is needed when water outlet temperature is less than 5°C.

2 Electrical Characteristics

System	Outdoor unit				Power current		Compressor		Fan	
	Voltage	Hz	Min.	Max.	MCA	MOP	MSC	RLA	kW	FLA
	(V)		(V)	(V)	(A)	(A)	(A)	(A)		(A)
MC-SS130-RN1TL	380-415	50	323	433	150	200	62	44.3	1.6	4
MC-SS260-RN1TL	380-415	50	323	433	250	320	62	44.3	1.6	4

Note:

MCA: Min. Circuit Amps. (A) (For wire diameter selection)

MOP: Maximum overcurrent protector (A)

MSC : Max. Starting Amps. (A)


RLA: Rated load amps. The input amps of compressor where maximum Hz can operate for nominal cooling or heating test condition

kW: Rated Motor Output


FLA: Full Load Amps. (A)

3 Dimensions and Center of Gravity

MC-SS130-RN1TL

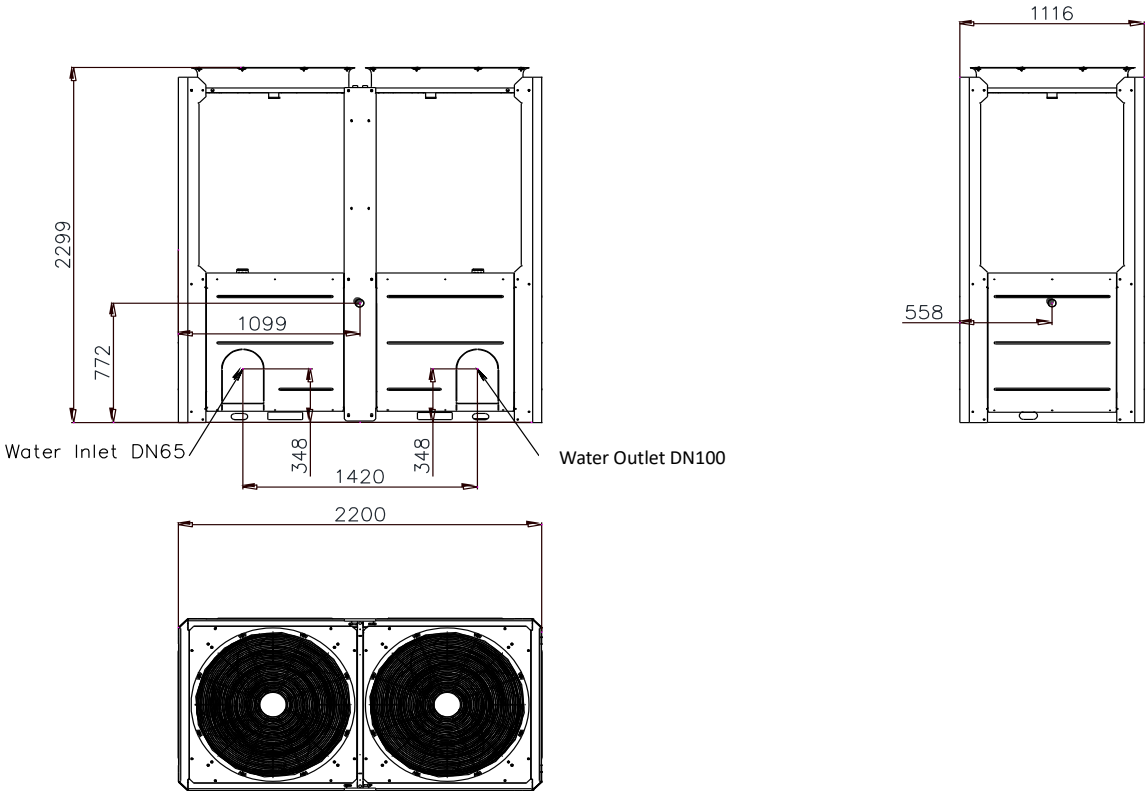


MC-SS260-RN1TL

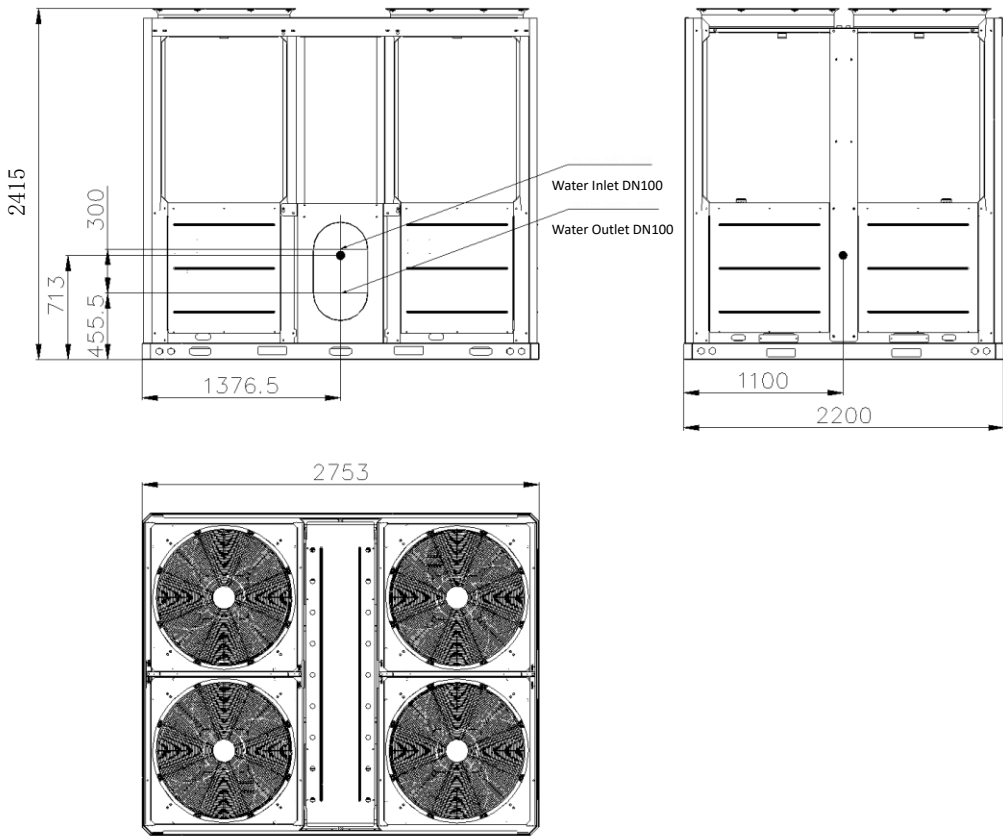

4 Operating Limits

4.1 Cooling operating range

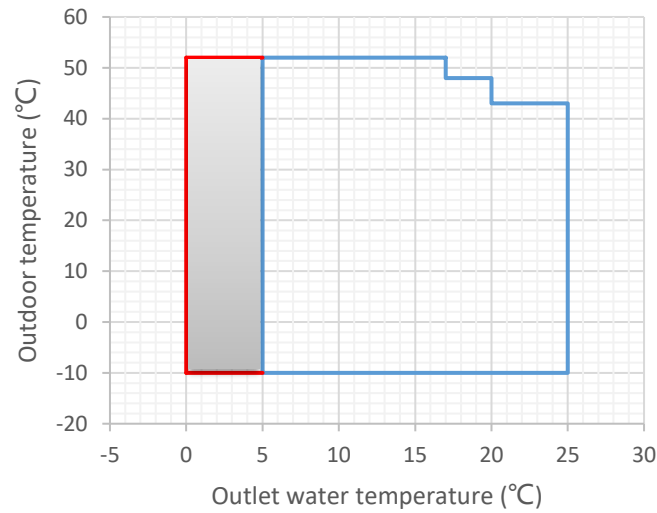


Notes:

- ① Normal mode
- ② Low leaving water temperature mode

Low leaving water temperature mode can be set through wired controller, please refer to the Operation Manual for details. If low leaving water temperature function is effective, the operation range will extend to the red frame above. When the set temperature is less than 5°C, antifreeze liquid (concentration above 15%) should be added in the water system, otherwise the unit will be damaged.

4.2 Heating operating range

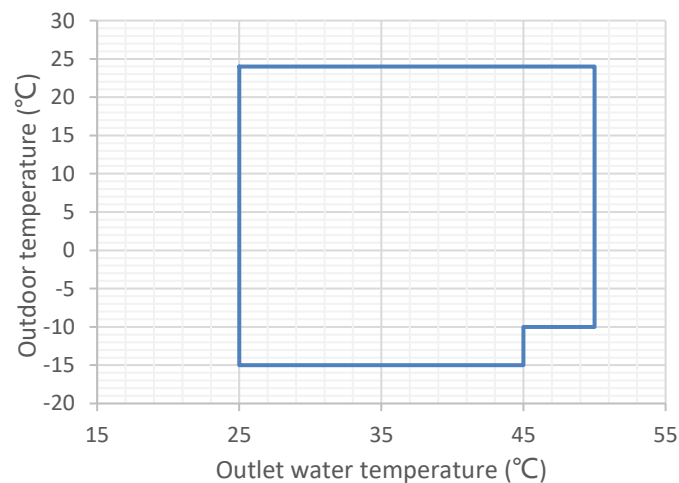

5 Capacity Tables

5.1 Heating Capacity Tables

MC-SS130-RN1TL

LWT °C	DB °C														
	-15			-10			-5			0			5		
	HC	PI	COP	HC	PI	COP	HC	PI	COP	HC	PI	COP	HC	PI	COP
25	72.58	17.81	4.08	87.58	20.81	4.21	109.20	24.13	4.53	136.12	28.70	4.74	148.69	32.78	4.54
30	70.39	18.24	3.86	85.39	21.24	4.02	108.33	24.88	4.35	134.40	30.01	4.48	147.28	34.07	4.32
35	70.42	20.63	3.41	85.42	23.63	3.61	107.12	27.18	3.94	133.70	32.21	4.15	146.94	35.43	4.15
40	70.61	23.91	2.95	85.61	26.91	3.18	107.01	30.57	3.50	132.90	35.45	3.75	146.58	37.89	3.87
45	60.92	26.76	2.28	75.92	29.76	2.55	95.49	33.82	2.82	119.64	39.22	3.05	132.75	41.92	3.17
50	/	/	/	70.33	33.03	2.13	77.70	39.19	1.98	98.22	45.44	2.16	109.64	48.58	2.26
LWT °C	DB °C														
	7			10			15			20			24		
	HC	PI	COP	HC	PI	COP	HC	PI	COP	HC	PI	COP	HC	PI	COP
25	153.72	34.42	4.47	173.37	36.12	4.80	193.75	38.28	5.06	205.21	40.08	5.12	219.57	41.57	5.28
30	152.43	35.69	4.27	172.50	36.82	4.68	192.27	39.33	4.89	204.55	41.03	4.98	218.45	42.50	5.14
35	152.24	36.72	4.15	172.28	37.95	4.54	191.97	40.29	4.76	203.98	42.25	4.83	218.27	44.89	4.86
40	152.05	38.87	3.91	170.29	41.20	4.13	189.56	44.35	4.27	203.80	46.65	4.37	218.00	48.96	4.45
45	138.00	43.00	3.21	153.18	45.58	3.36	177.74	48.01	3.70	186.99	50.54	3.70	196.23	52.07	3.77
50	114.21	49.83	2.29	125.63	52.81	2.38	142.68	54.96	2.60	156.89	56.62	2.77	174.30	58.29	2.99

MC-SS260-RN1TL

LWT °C	DB °C														
	-15			-10			-5			0			5		
	HC	PI	COP	HC	PI	COP	HC	PI	COP	HC	PI	COP	HC	PI	COP
25	147.26	35.12	4.19	177.69	41.04	4.33	221.57	47.59	4.66	276.20	56.61	4.88	301.70	64.65	4.67
30	142.82	35.96	3.97	173.25	41.88	4.14	219.79	49.07	4.48	272.70	59.18	4.61	298.82	67.19	4.45
35	142.87	40.69	3.51	173.31	46.61	3.72	217.35	53.59	4.06	271.27	63.53	4.27	298.14	69.87	4.27
40	143.27	47.15	3.04	173.70	53.07	3.27	217.12	60.29	3.60	269.64	69.91	3.86	297.40	74.73	3.98
45	123.61	52.77	2.34	154.04	58.69	2.62	193.75	66.70	2.90	242.75	77.34	3.14	269.36	82.67	3.26
50	/	/	/	142.70	65.14	2.19	157.65	77.29	2.04	199.28	89.61	2.22	222.46	95.80	2.32
LWT °C	DB °C														
	7			10			15			20			24		
	HC	PI	COP	HC	PI	COP	HC	PI	COP	HC	PI	COP	HC	PI	COP
25	311.90	67.87	4.60	351.77	71.24	4.94	393.12	75.50	5.21	416.38	79.05	5.27	445.50	81.98	5.43
30	309.27	70.39	4.39	350.00	72.61	4.82	390.10	77.57	5.03	415.02	80.92	5.13	443.23	83.82	5.29
35	308.88	72.41	4.27	349.56	74.84	4.67	389.51	79.46	4.90	413.87	83.31	4.97	442.87	88.52	5.00
40	308.51	76.66	4.02	345.52	81.25	4.25	384.62	87.46	4.40	413.50	92.00	4.49	442.32	96.55	4.58
45	280.00	84.80	3.30	310.80	89.89	3.46	360.62	94.67	3.81	379.40	99.67	3.81	398.15	102.69	3.88
50	231.73	98.27	2.36	254.90	104.15	2.45	289.50	108.38	2.67	318.34	111.66	2.85	353.66	114.95	3.08

Abbreviations:

DB: Dry-bulb temperature for outdoor air temperature (°C)

LWT: Leaving water temperature (°C)

HC: Total heating capacity (kW)

PI: Power input (kW)

Performance specifications measured with water pump operating at rated water flow rate.

5.2 Cooling Capacity Tables

MC-SS130-RN1TL

LWT °C	DB °C														
	-10			-5			0			5			10		
	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER
0	120.89	29.15	4.15	116.61	29.75	3.92	112.33	30.35	3.70	106.78	31.34	3.41	104.22	31.33	3.33
5	148.33	33.99	4.36	143.71	34.50	4.16	140.08	35.02	4.00	135.97	35.57	3.82	130.86	36.12	3.62
7	156.70	35.25	4.45	151.49	35.80	4.23	147.29	36.34	4.05	144.65	36.89	3.92	142.00	37.44	3.79
10	168.46	37.19	4.53	163.29	37.75	4.33	160.12	38.32	4.18	156.62	38.92	4.02	153.12	39.52	3.87
15	189.10	38.86	4.87	184.52	39.46	4.68	179.94	40.06	4.49	172.18	40.68	4.23	169.09	41.51	4.07
17	196.87	39.73	4.96	190.30	40.07	4.75	188.14	40.67	4.63	180.84	41.30	4.38	178.54	41.93	4.26
20	204.87	41.03	4.99	198.30	41.37	4.79	196.14	41.97	4.67	188.84	42.60	4.43	186.54	43.23	4.31
25	212.87	42.33	5.03	206.30	42.67	4.84	204.14	43.27	4.72	196.84	43.90	4.48	194.54	44.53	4.37

LWT °C	DB °C														
	15			20			25			30			35		
	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER
0	102.29	31.48	3.25	100.57	32.16	3.13	98.61	33.09	2.98	96.24	34.23	2.81	94.30	35.12	2.69
5	127.63	36.63	3.48	124.54	37.25	3.34	122.04	38.41	3.18	120.29	39.59	3.04	118.20	40.82	2.90
7	139.32	37.97	3.67	136.71	38.61	3.54	134.34	39.80	3.38	131.54	40.98	3.21	130.00	42.30	3.07
10	148.75	40.08	3.71	144.31	40.75	3.54	141.55	42.01	3.37	138.75	43.31	3.20	136.82	44.65	3.06
15	166.00	41.88	3.96	159.30	42.59	3.74	154.52	43.91	3.52	150.90	45.27	3.33	145.34	46.67	3.11
17	175.72	42.52	4.13	167.53	43.23	3.88	160.92	44.57	3.61	156.57	45.95	3.41	148.35	47.37	3.13
20	183.72	43.82	4.19	175.53	44.53	3.94	168.92	45.87	3.68	164.57	47.25	3.48	156.35	48.67	3.21
25	191.72	45.12	4.25	183.53	45.83	4.00	176.92	47.17	3.75	172.57	48.55	3.55	164.35	49.97	3.29

LWT °C	DB °C											
	40			43			48			52		
	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER
0	92.21	37.49	2.46	91.15	39.32	2.32	90.15	41.32	2.18	88.15	43.32	2.03
5	115.50	41.86	2.76	111.34	43.00	2.59	108.34	45.00	2.41	106.34	47.00	2.26
7	127.07	43.42	2.93	122.55	45.17	2.71	117.55	47.17	2.49	115.55	49.17	2.35
10	132.59	45.88	2.89	128.57	47.23	2.72	122.57	49.23	2.49	120.57	51.23	2.35
15	139.11	48.00	2.90	136.81	49.45	2.77	129.81	51.45	2.52	127.81	53.45	2.39
17	141.17	48.74	2.90	137.82	50.22	2.74	132.82	52.22	2.54	130.82	54.22	2.41
20	149.17	50.04	2.98	145.82	51.52	2.83	140.42	53.62	2.62	/	/	/
25	157.17	51.34	3.06	153.82	52.82	2.91	/	/	/	/	/	/

Abbreviations:

DB: Dry-bulb temperature for outdoor air temperature (°C)

LWT: Leaving water temperature (°C)

CC: Total cooling capacity (kW)

PI: Power input (kW)

Performance specifications measured with water pump operating at rated water flow rate.

King Plus

MC-SS260-RN1TL



LWT °C	DB °C														
	-10			-5			0			5			10		
	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER
0	246.43	57.88	4.26	237.71	59.07	4.02	228.98	60.27	3.80	217.66	62.23	3.50	212.45	62.21	3.41
5	302.37	67.49	4.48	292.94	68.52	4.28	285.55	69.54	4.11	277.17	70.63	3.92	266.76	71.72	3.72
7	319.42	69.99	4.56	308.81	71.08	4.34	300.25	72.17	4.16	294.85	73.27	4.02	289.46	74.36	3.89
10	343.40	73.85	4.65	332.86	74.97	4.44	326.40	76.10	4.29	319.27	77.29	4.13	312.13	78.48	3.98
15	385.48	77.17	5.00	376.14	78.36	4.80	366.81	79.55	4.61	350.98	80.77	4.35	344.68	82.43	4.18
17	401.31	78.90	5.09	387.91	79.56	4.88	383.51	80.75	4.75	368.63	82.01	4.49	363.94	83.27	4.37
20	417.62	81.48	5.13	404.22	82.15	4.92	399.82	83.34	4.80	384.94	84.59	4.55	380.25	85.85	4.43
25	433.93	84.06	5.16	420.52	84.73	4.96	416.13	85.92	4.84	401.25	87.17	4.60	396.55	88.43	4.48

LWT °C	DB °C														
	15			20			25			30			35		
	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER
0	208.51	62.51	3.34	205.00	63.86	3.21	201.01	65.72	3.06	196.18	67.98	2.89	192.23	69.74	2.76
5	260.16	72.75	3.58	253.87	73.97	3.43	248.77	76.28	3.26	245.21	78.62	3.12	240.95	81.06	2.97
7	284.00	75.41	3.77	278.68	76.67	3.63	273.85	79.04	3.46	268.14	81.38	3.29	265.00	84.00	3.15
10	303.23	79.59	3.81	294.17	80.92	3.64	288.54	83.42	3.46	282.84	86.01	3.29	278.90	88.67	3.15
15	338.38	83.17	4.07	324.73	84.58	3.84	314.98	87.20	3.61	307.60	89.90	3.42	296.27	92.68	3.20
17	358.19	84.44	4.24	341.50	85.85	3.98	328.03	88.51	3.71	319.16	91.25	3.50	302.41	94.07	3.21
20	374.50	87.02	4.30	357.81	88.43	4.05	344.34	91.09	3.78	335.47	93.83	3.58	318.71	96.65	3.30
25	390.80	89.60	4.36	374.12	91.01	4.11	360.64	93.67	3.85	351.78	96.41	3.65	335.02	99.23	3.38

LWT °C	DB °C											
	40			43			48			52		
	CC	PI	EER	CC	PI	EER	CC	PI	EER	CC	PI	EER
0	187.98	74.44	2.53	185.81	78.09	2.38	183.77	82.06	2.24	179.70	86.03	2.09
5	235.44	83.13	2.83	226.96	85.39	2.66	220.85	89.36	2.47	216.77	93.33	2.32
7	259.03	86.22	3.00	249.81	89.70	2.79	239.62	93.67	2.56	235.54	97.64	2.41
10	270.28	91.11	2.97	262.09	93.79	2.79	249.85	97.76	2.56	245.78	101.73	2.42
15	283.57	95.32	2.97	278.88	98.20	2.84	264.61	102.17	2.59	260.54	106.14	2.45
17	287.77	96.79	2.97	280.94	99.73	2.82	270.75	103.70	2.61	266.67	107.67	2.48
20	304.08	99.37	3.06	297.25	102.31	2.91	286.24	106.48	2.69	/	/	/
25	320.39	101.95	3.14	313.56	104.89	2.99	/	/	/	/	/	/

Abbreviations:

DB: Dry-bulb temperature for outdoor air temperature (°C)

LWT: Leaving water temperature (°C)

CC: Total cooling capacity (kW)

PI: Power input (kW)

Performance specifications measured with water pump operating at rated water flow rate.

6 Performance Adjustment Factors

6.1 Ethylene and Propylene Glycol factors

The antifreeze must be required according to anyone condition as following:

- The ambient temperature is below 0 °C;
- Don't start up the unit for a long time.
- The power supply was cut off and needn't change the water in system.

A glycol solution is required when the unit with condition as mentioned. The use of glycol will reduce the performance of the unit depending on concentration.

Concentration of ethylene glycol (%)	Modification coefficient				Freezing point (°C)
	Cooling capacity	Power input	Water resistance	Water flow	
0	1.000	1.000	1.000	1.000	0
10	0.984	0.998	1.118	1.019	-4
20	0.973	0.995	1.268	1.051	-9
30	0.965	0.992	1.482	1.092	-16
40	0.960	0.989	1.791	1.145	-23
50	0.950	0.983	2.100	1.200	-37

Concentration of propylene glycol (%)	Modification coefficient				Freezing point (°C)
	Cooling capacity	Power input	Water resistance	Water flow	
0	1.000	1.000	1.000	1.000	0
10	0.976	0.996	1.071	1.00	-3
20	0.961	0.992	1.189	1.016	-7
30	0.948	0.988	1.380	1.034	-13
40	0.938	0.984	1.728	1.078	-22
50	0.925	0.975	2.150	1.125	-35

6.2 Evaporator temperature drop factors

Performance tables are based on a 5°C temperature drop through the evaporator. Temperature drops outside this range can affect the control system's capability to maintain acceptable control and are not recommended.

6.3 Altitude correction factors

Performance tables are based at sea level. Elevations other than sea level affect the performance of the unit. The decreased air density will reduce condenser capacity and reduce the unit's performance. Maximum allowable altitude is 1800 meters.

6.4 Fouling factor

Fouling refers to the accumulation of unwanted material on solid surfaces, most often in an aquatic environment. The fouling material can consist of either living organisms (biofouling) or a non-living substance (inorganic or organic). Fouling is usually distinguished from other surface-growth phenomena in that it occurs on a surface of a component, system or plant performing a defined and useful function, and that the fouling process impedes or interferes with this function.

Other terms used in the literature to describe fouling include: deposit formation, encrustation, crudding, deposition, scaling, scale formation, slagging, and sludge formation. The last six terms have a more narrow meaning than fouling within the scope of

King Plus



the fouling science and technology, and they also have meanings outside of this scope; therefore, they should be used with caution.

Fouling phenomena are common and diverse, ranging from fouling of ship hulls, natural surfaces in the marine environment (marine fouling), fouling of heat-transfer components through ingredients contained in the cooling water or gases, and even the development of plaque or calculus on teeth, or deposits on solar panels on Mars, among other examples.


Foreign matter in the chilled water system will adversely affect the heat transfer capability of the evaporator, and could increase the pressure drop and reduce the water flow. To provide optimum unit operation, proper water treatment must be maintained. Refer to the table as following.

ALTITUDE (m)	Difference of water inlet and outlet temp. (°C)	Fouling Factor							
		0.018 m ² . °C /kW		0.044 m ² . °C /kW		0.086 m ² . °C /kW		0.172 m ² . °C /kW	
		C	P	C	P	C	P	C	P
Sea level	3	1.036	1.077	1.019	1.076	0.991	0.975	0.963	0.983
	4	1.039	1.101	1.022	1.080	0.994	0.996	0.971	0.984
	5	1.045	1.105	1.028	1.086	1.000	1.000	0.977	0.989
	6	1.051	1.109	1.034	1.093	1.006	1.004	0.983	0.994
600	3	1.024	1.087	1.008	1.064	0.980	0.984	0.951	0.991
	4	1.027	1.111	1.011	1.068	0.983	1.005	0.959	0.992
	5	1.034	1.115	1.017	1.074	0.989	1.009	0.965	0.997
	6	1.043	1.115	1.026	1.084	0.998	1.009	0.973	0.999
1200	3	1.013	1.117	0.996	1.052	0.969	1.011	0.942	1.002
	4	1.015	1.118	0.998	1.055	0.971	1.012	0.948	1.003
	5	1.023	1.122	1.006	1.063	0.979	1.015	0.955	1.005
	6	1.031	1.125	1.015	1.072	0.987	1.018	0.962	1.007
1800	3	1.002	1.128	0.986	1.042	0.959	1.021	0.935	1.007
	4	1.005	1.129	0.989	1.045	0.962	1.022	0.941	1.010
	5	1.012	1.132	0.995	1.051	0.968	1.024	0.945	1.012
	6	1.018	1.134	1.001	1.058	0.974	1.026	0.949	1.014


Abbreviations:
C: Cooling capacity
P: Power input

7 Hydronic Performance

MC-SS130-RN1TL

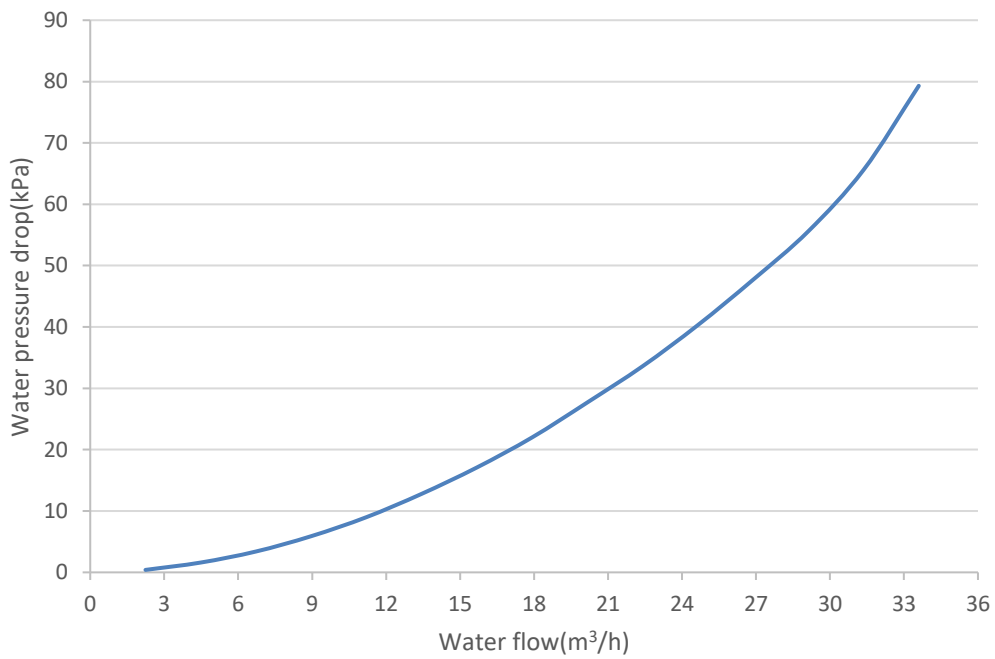


MC-SS260-RN1TL

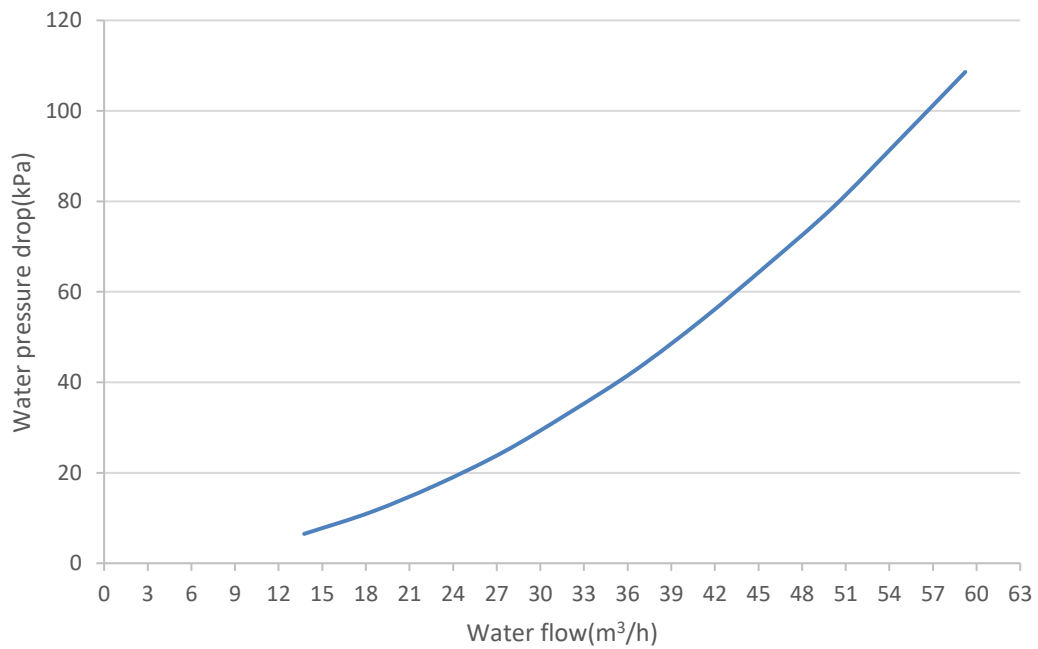


8 Octave Band Levels

Test bearing

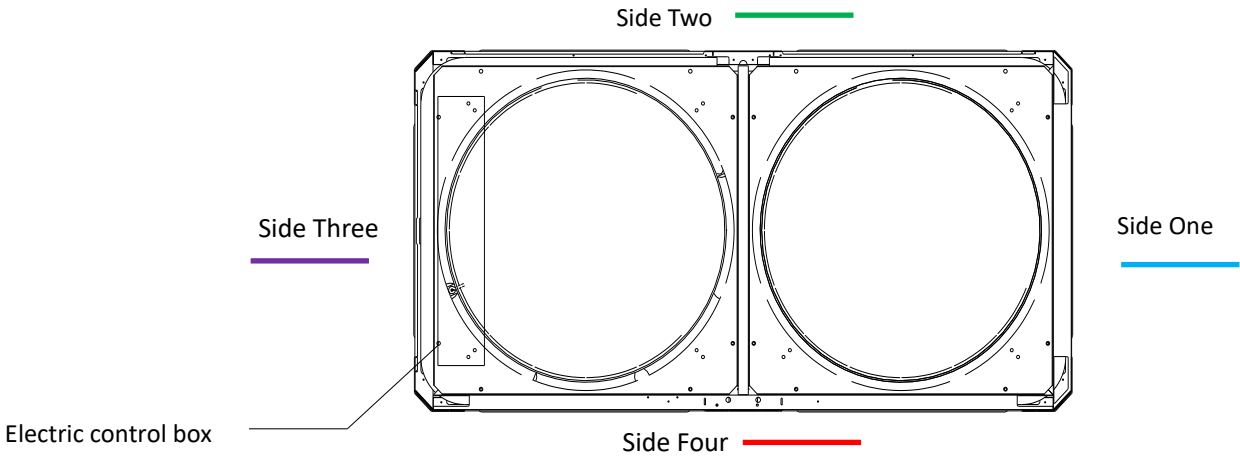


Test condition: Outdoor ambient temperature 35°C DB. EWT 12°C, LWT 7°C

MC-SS130-RN1TL

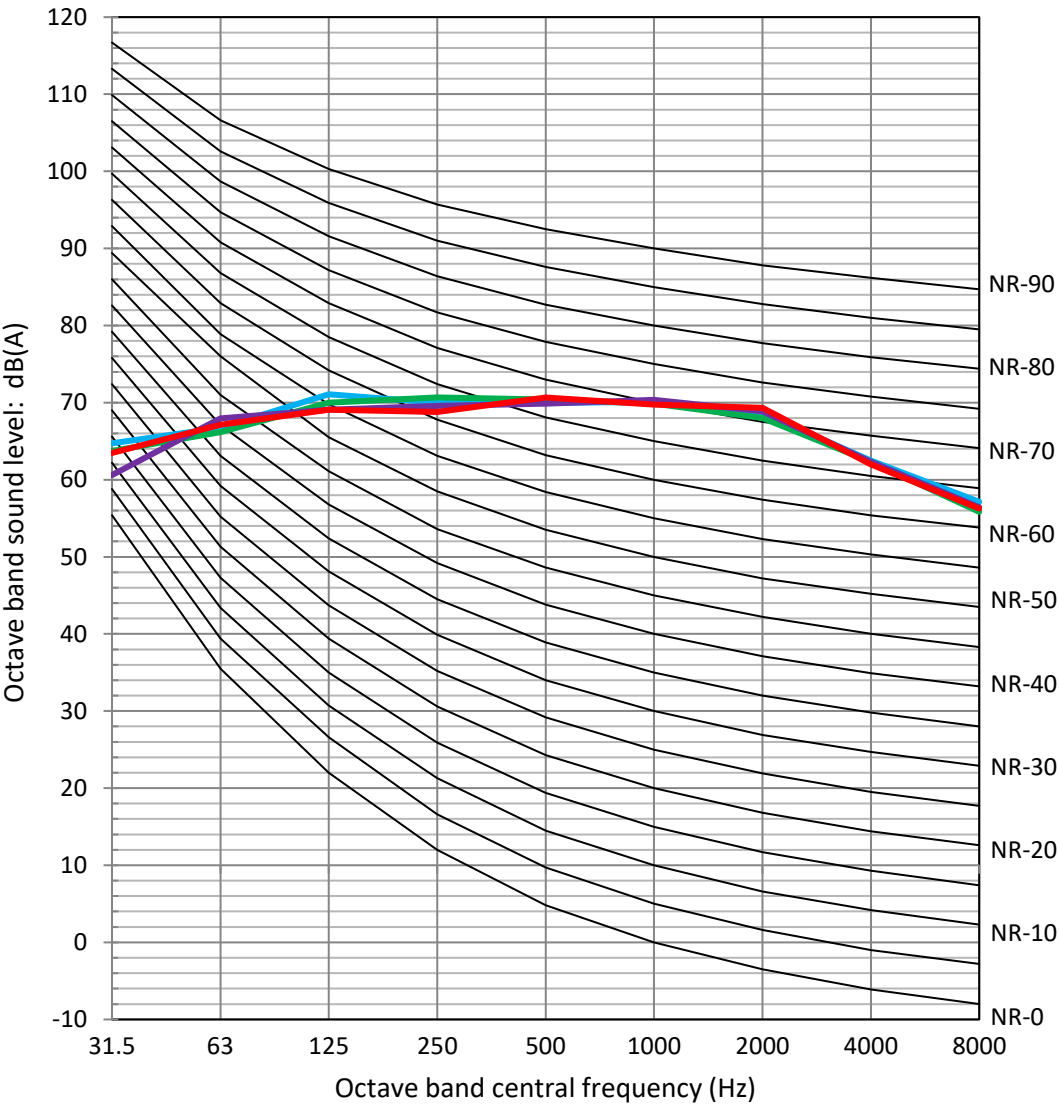


Test bearing

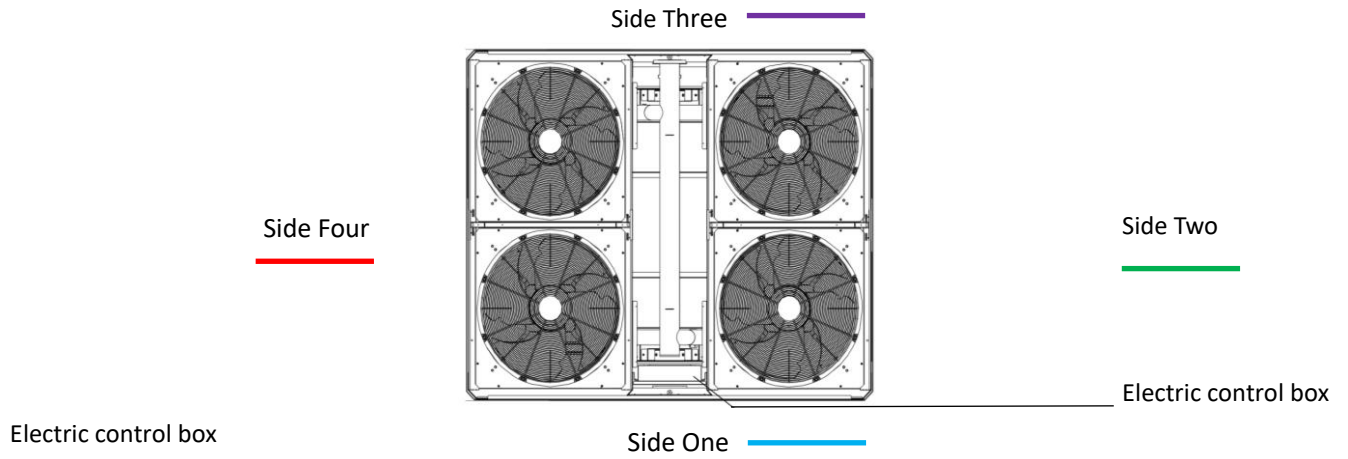

Test condition: Outdoor ambient temperature 35°C DB. EWT 12°C, LWT 7°C

MC-SS260-RN1TL

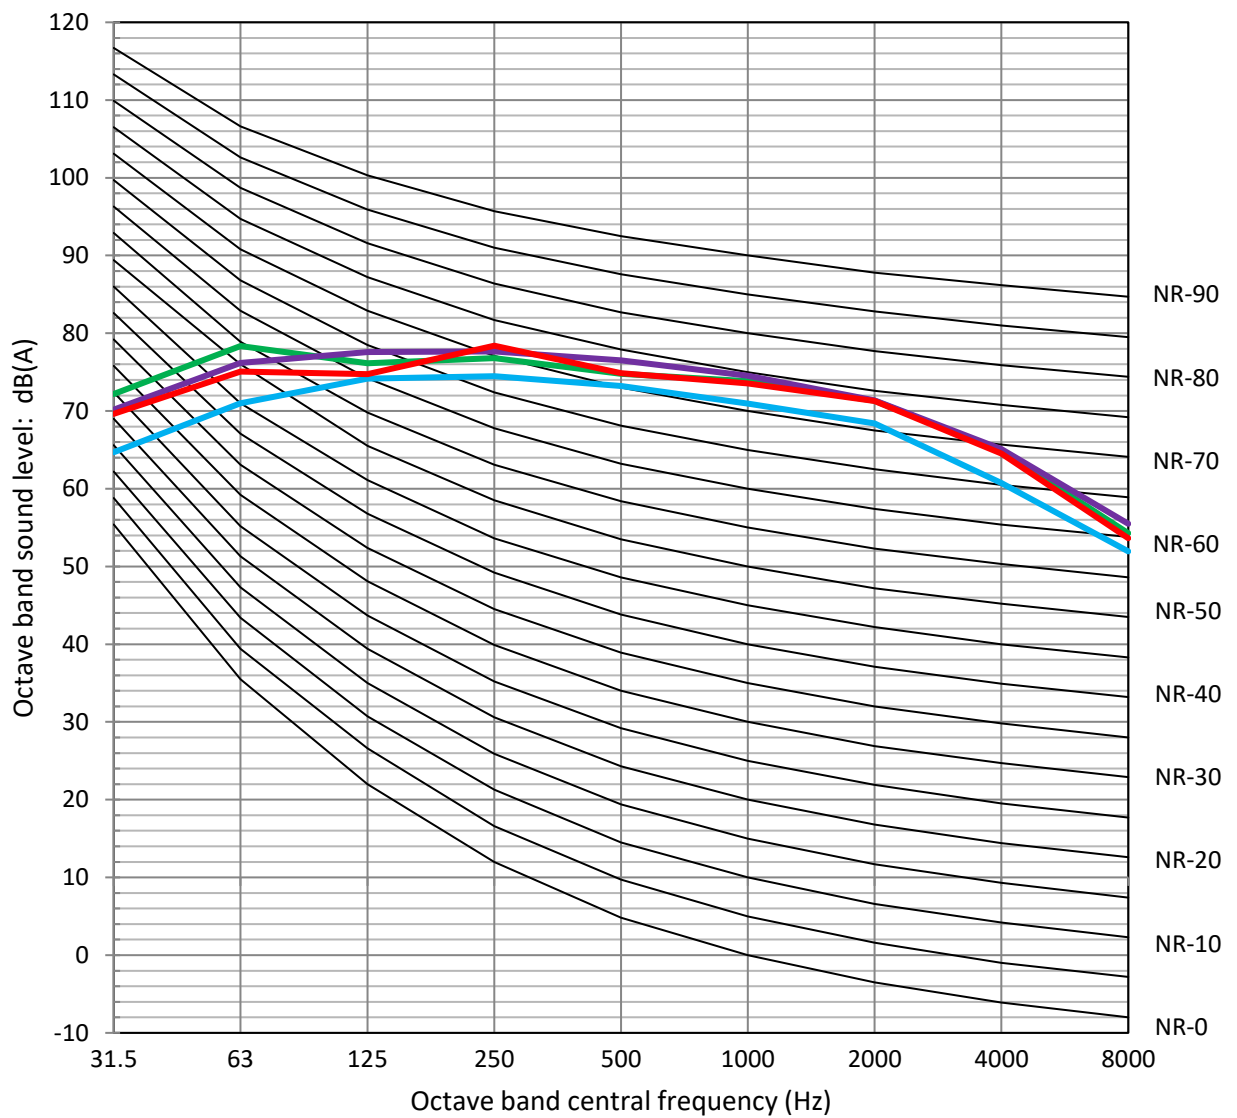

Part 3


Wired Controller

1. Specifications	26
2. Introduction of function buttons	26
3. Normal Operating Parameters	28

1. Specifications

Model	KJRM-120D/BMK-E(Modbus)	KJRM-120D/BMK-E(Modbus)
Adaptation model	MC-SS130-RN1TL	MC-SS260-RN1TL
Input Voltage	10V	10V
Operating environment temperature	-10°C~+43°C	-10°C~+43°C
Operating RH of wired controller	RH 40%~RH90%	RH 40%~RH90%


2. Introduction of function buttons

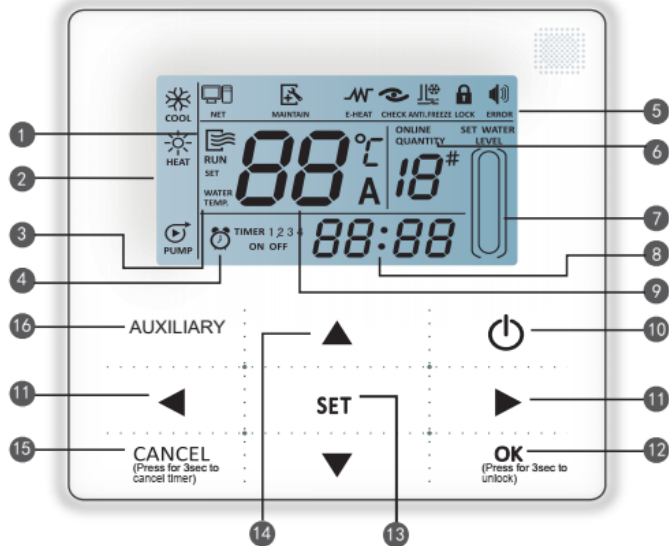

① **Operation icon** (RUN): Indicate the ON and OFF status; when it is ON, it will display; when it is OFF, it will disappear

② **Mode area**: Indicate the main unit operating mode;

③ **Setting temperature**: 2 statuses can be displayed -



④ **Timing ON/OFF indication** (TIMER 1 2 3): Indicate the timing information.

⑤ **Function icon**:

- ✧ : Display when unit connects to Modbus network;
- ✧ : Displays when unit maintenance is needed. Press and hold 'AUXILIARY' key for 3 seconds to cancel the icon and timing will restart until next maintenance.
- ✧ : Displays when electric auxiliary heating function is on.
- ✧ : Displays when check function is on.
- ✧ : Displays when ambient temperature is below 2°C which means the main unit need anti-freezing

action.

- ✧  **LOCK** : Displays when no key operation for 2 minutes and all keys are locked. Press and hold 'OK' key for 3 seconds to unlock.

- ✧  **ERROR** : Displays when error or protection occurs and means the unit need maintenance by professionals.

⑥ **Online quantity indication:** Under normal status display the quantity of units connected to the wired controller; under check status display the device serial number.

⑦ **Reserved**

⑧ **Clock:** Under normal status displays clock; under timing setting displays the setting timing.

⑨ **Water temperature:** Under normal status display water temperature; under water temperature setting status displays the setting value; under check status displays check parameter.

⑩ **ON/OFF key (⏻):** Turn on and turn off functions.

⑪ **Right and left key (◀ and ▶):** Press these keys to check setting water temperature, setting timing etc; press right key to shift to the next step setting under timing setting status. Press these keys to turn over the unit parameter information under check status.

⑫ **OK key:** Press this key to confirm settings. Press and hold this key for 3 seconds to unlock under locking status.

⑬ **Setting key:** Setting water temperature, timing and mode, etc. Press and hold this key for 3 seconds to enter check status.

⑭ **Add and Reduce key (▲ and ▼):** Move up or move down values of temperature, timing, etc. Turn over #0~#15 units under check status.

⑮ **Cancel key:** Press this key to cancel parameter setting under setting status; press and hold this key for 3 seconds to cancel timing when timing is valid.

⑯ **Reserved**

3. Normal Operating Parameters

Unit in normal cooling mode operating parameters

Outdoor ambient temperature	°C	< -10	-10~0	0~15	15~30	30~43	43~48	48~52	> 52
Discharge temperature	°C	60~85	65~95	68~95	70~95	74~98	78~96	78~100	80~104
Discharge superheat	°C	22~30	27~42	28~42	27~40	28~40	22~35	18~36	18~50
Discharge pressure	Mpa	2.2~3.0	2.2~3.2	2.3~3.2	2.5~3.3	2.7~3.6	3.4~3.8	3.7~4.1	3.9~4.2
Suction pressure	Mpa	0.5~0.7	0.5~0.8	0.6~0.8	0.6~0.9	0.6~0.9	0.7~1.0	0.8~1.2	0.9~1.2
AC inverter compressor current	A	56~68	65~82	70~88	70~90	70~90	76~95	80~98	88~105

Unit in normal heating mode operating parameters

Outdoor ambient temperature	°C	< -10	-10to0	0to5	5to10	10to17	17to24	> 24
Discharge temperature	°C	66-105	70-100	70-90	74-85	70-100	68-100	65-100
Discharge superheat	°C	30-59	30-49	27-37	26-32	19-44	16-41	12-39
Discharge pressure	Mpa	2.1-2.7	2.3-3.0	2.4-3.2	2.8-3.2	3.0-3.4	3.1-3.6	3.2-3.8
Suction pressure	Mpa	0.2-0.5	0.3-0.5	0.4-0.6	0.5-0.7	0.5-0.8	0.6-0.9	0.7-1.0
AC inverter compressor current	A	54-68	60-75	68-80	70-85	78-92	83-96	86-100

Midea Building Technologies Division
Midea Group

Add.: Midea Headquarters Building, 6 Midea Avenue, Shunde, Foshan, Guangdong, China

Postal code: 528311

mbt.midea.com / global.midea.com

Midea reserves the right to change the specifications of the product, and to withdraw or replace products without prior notification or public announcement. Midea is constantly developing and improving its products.

